

Report on the Failure Rate of Bare Concentric Neutral 600-Volt Cable


Neal Parker, P.E.
Engineer



PUGET SOUND ENERGY

pse.com

Bare Concentric Neutral 600-Volt Cable

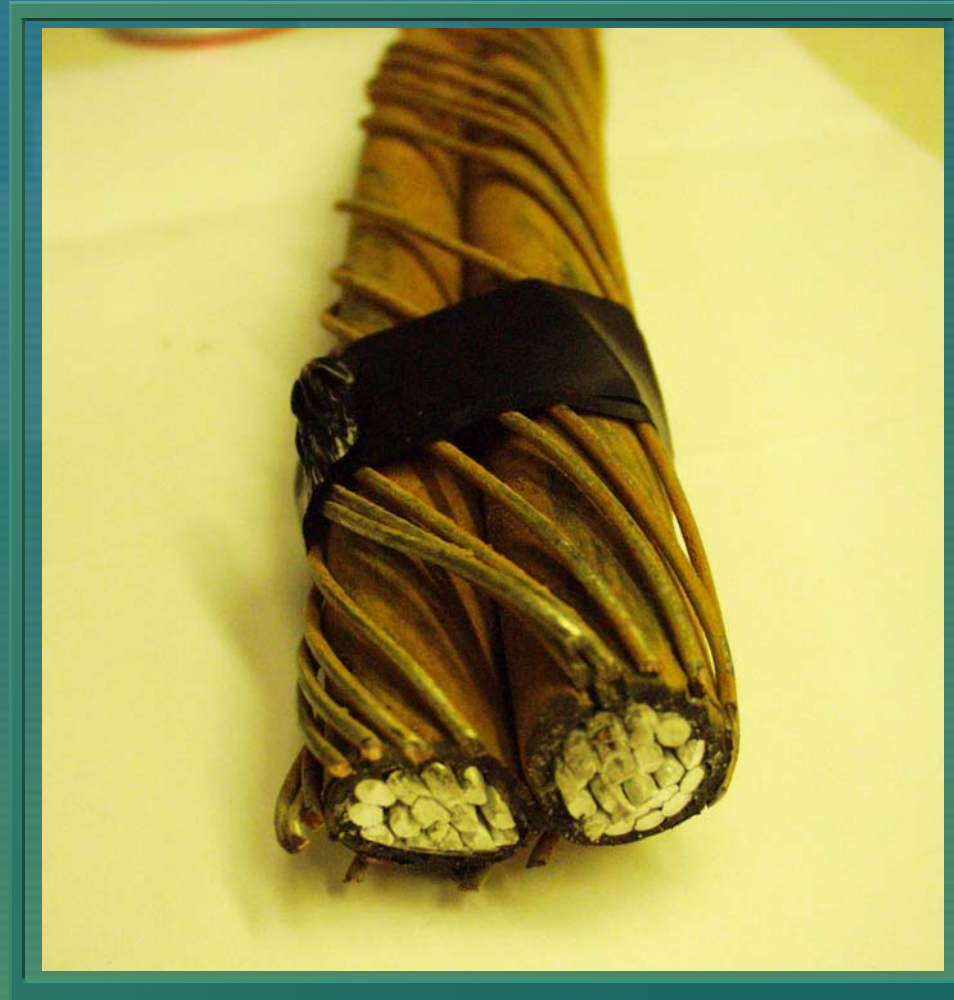

A page from the 1966 annual report says that a total of 7427 underground services had been installed by the end of 1966.



THE LAST POLE was cut up and burned by community members near Bellevue as a symbol of success in having their utility wires buried. Nearly all of the 132 home owners in the neighborhood volunteered to share in the cost of the beautification project. Puget Power is winning a large measure of customer and public good will for its aggressive underground wiring program. The low-cost Total Underground wiring methods developed by our engineers in 1964 have made it possible to install underground systems to serve over 7,000 home sites within the past two years. Underground utility systems for an additional 5,000 lots are under construction. For its development and promotion of Total Underground, Puget Power was selected as Marketing Company of the Year for 1966 by the Puget Sound Chapter of The American Marketing Association.

UNDERGROUND SERVICE
TO CUSTOMERS

7,427 '66 | '65 3,329